


32 NORTH PLAN

NOTES:
1. TRACE ROUTING & EQUIPMENT OF ALL RELOCATED CONDUITS PRIOR TO CUTTING.

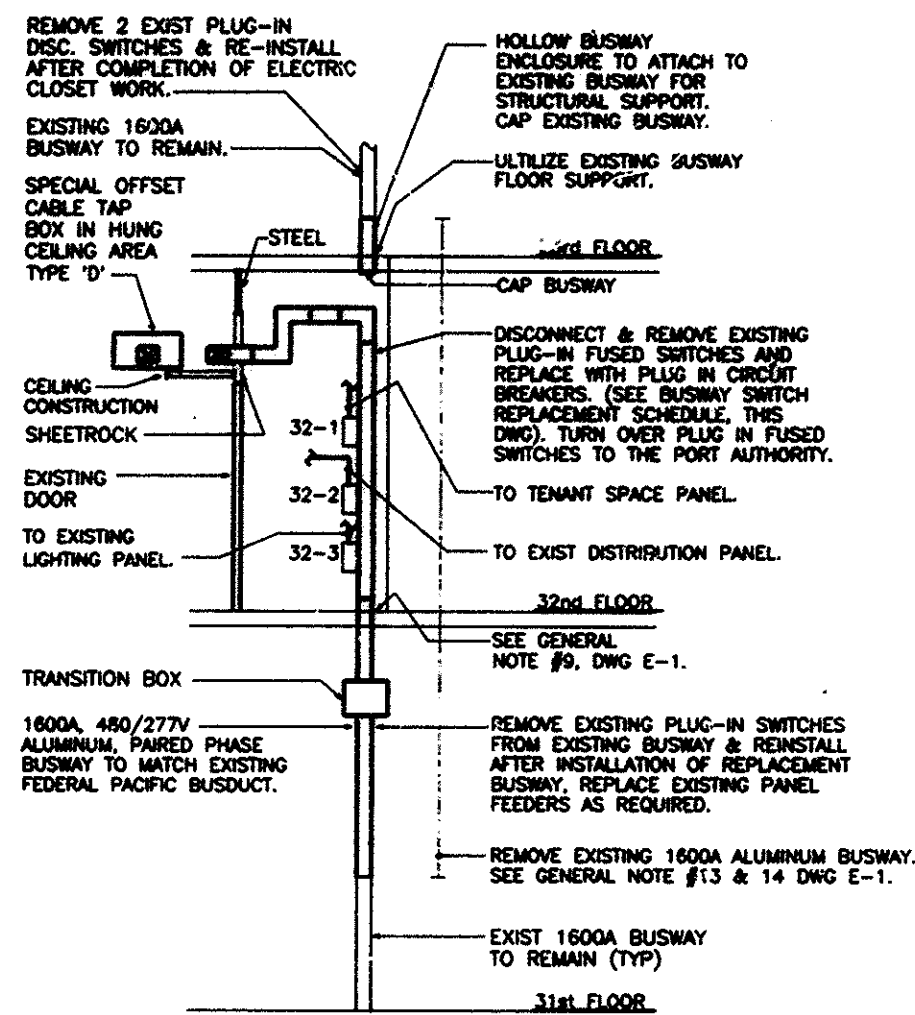


**32nd FLOOR SECTION A-A
& PART RISER**

NOTES:


1. SEE DRAWING E-1 FOR GENERAL NOTES AND BUSWAY SCHEDULE.

#	EXIST. SW. SIZE	EXIST. FUSE RATING	NEW BREAKER RATING	NEW FEEDER	NEW COT	REMARKS
32-1	200A	125A	225AF/125AT	4#1 CU	1 1/2"	
32-2	200A	200A	225AF/200AT	4#3/0 CU	2"	
32-3	200A	125A	225AF/125AT	4#1 CU	1 1/2"	

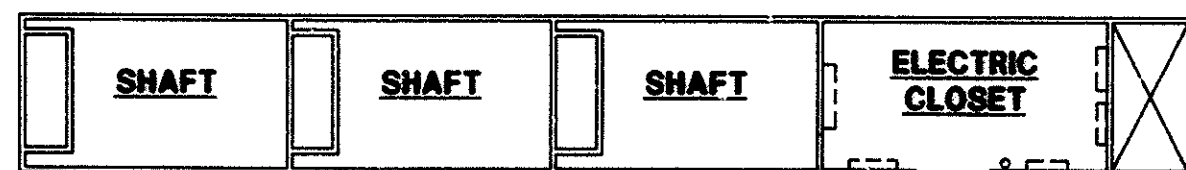

32 NORTH - LIGHTING PLAN

NOTES:
1. COORDINATE WITH ARCHITECT FOR EXACT LOCATION OF RELOCATED LIGHT FIXTURES.
2. COORDINATE LOCATION OF FIXTURES WITH MECHANICAL DUCTS & STRUCTURAL TRUSS ABOVE.

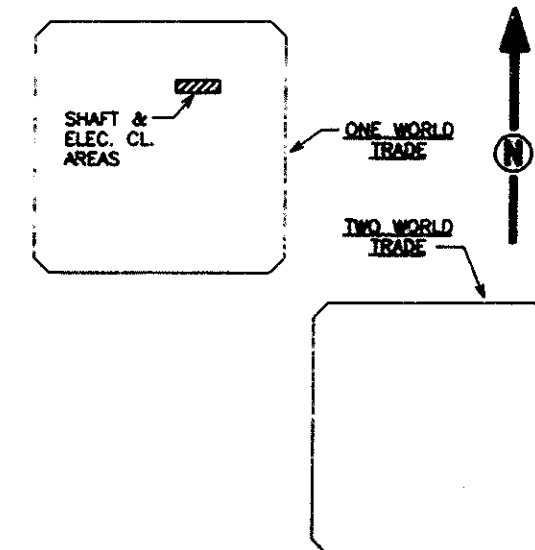

Sheet 21 of 41



EDWARDS AND ZUCK, P.C.
CONSULTING ENGINEERS

James Zuck
Engineering Program Manager I

330 West 42nd Street, New York, NY 10036
212-725-7000
© 1992 Edwards and Zuck, P.C.



9/15/01 Drawings of Record
No. Date Revision Approved

Engineering Department
Design Division

The World Trade Center
Electrical/HVAC
Upgrade Program

Title
**LOW VOLTAGE DISTRIBUTION
ONE WTC
ELECTRICAL
32ND FLOOR
NORTH SIDE**

ELECTRIC CLOSET PART PLAN

This drawing subject to conditions in contract. All inventions, ideas, designs or methods herein are reserved to Port Authority and may not be used without its written consent.

CJ/CAD MW/CADD FJL
Designed by Drawn by Checked by

Date 10/4/93 Scale 1/4" = 1'-0"

Contract Number Drawing Number

WTC-8-4.041 E-4

FILE NAME: PATED24P